

MURFREESBORO ELECTRIC DEPARTMENT


615-893-5514

OVERHEAD COMMERCIAL TEMP. SERVICE

Date:	# of pages:
To:	From:
Co./Dept.:	Co./Dept.:
Phone #:	Phone #:
Fax #:	Fax #:

COMMERCIAL

Point of service drop attach minimum of 18' (at least a 25' wood pole with 4 1/2" in ground) due to truck traffic. No bracing necessary, but if length of pull is greater than 75', then the developer will provide guying against direction of pull.

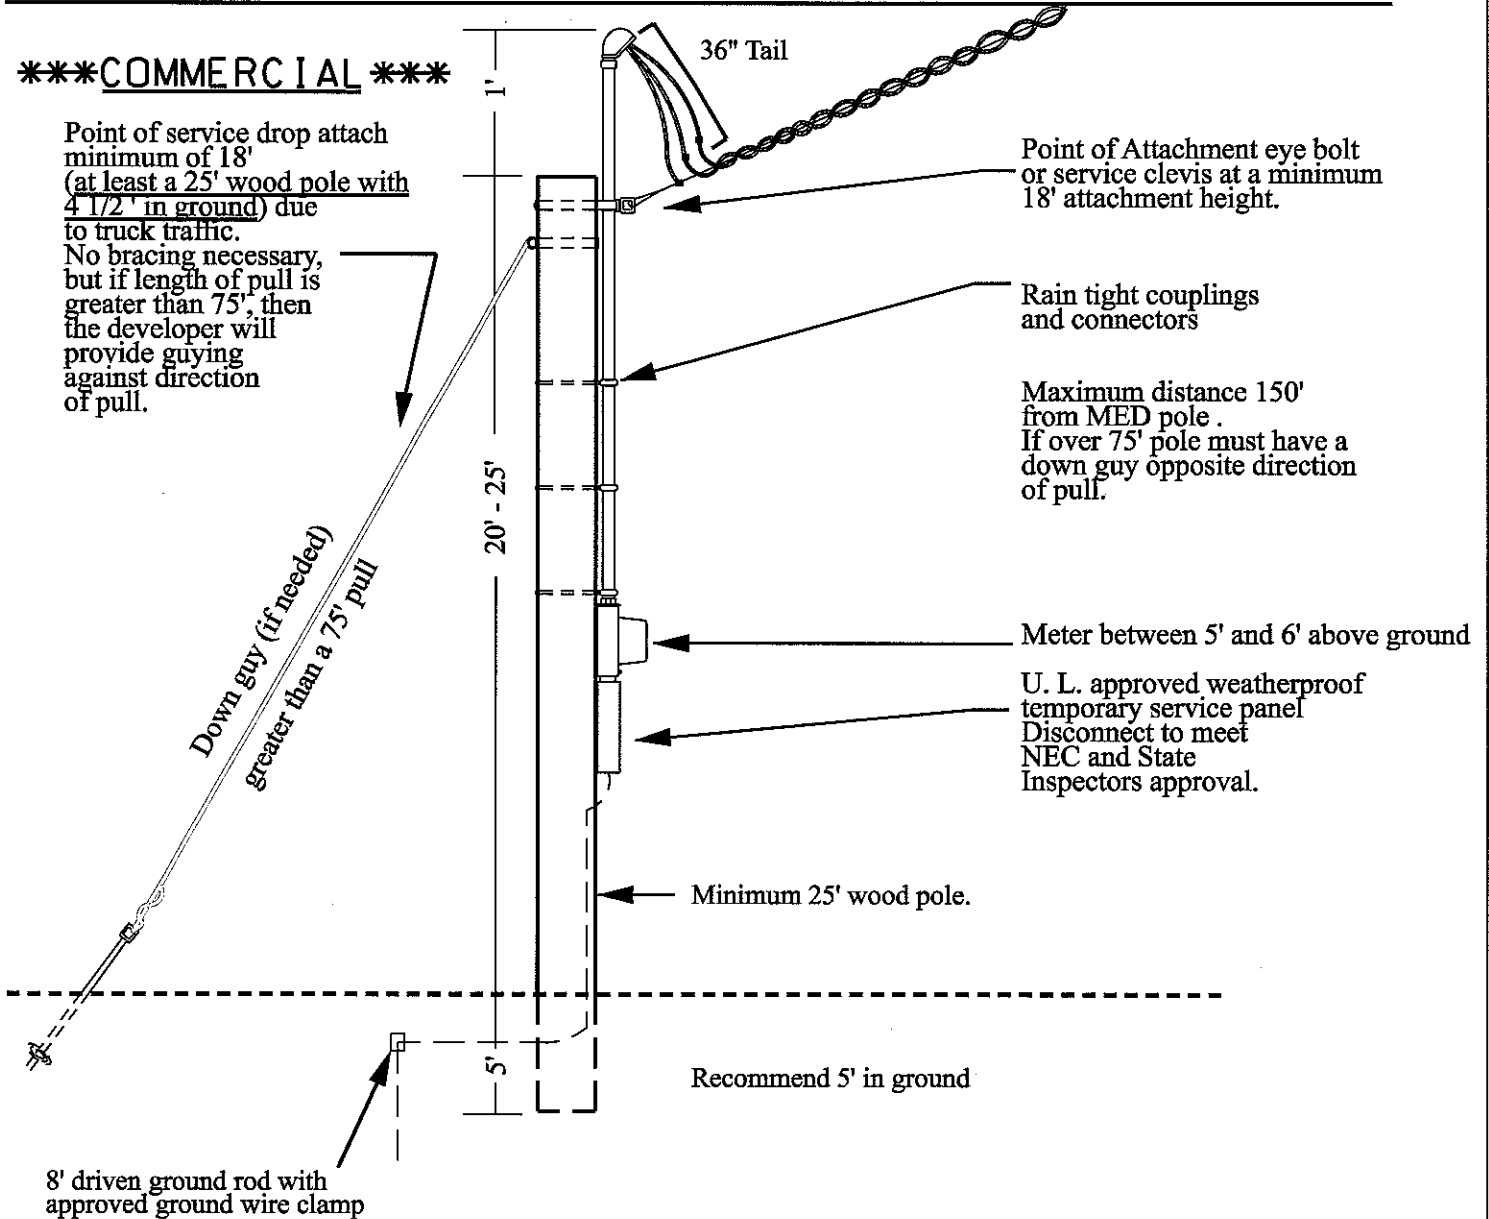

Must have current electrical inspection to be connected by MED.

Have Engineer to spot location on site for temporary service and permanent meter location.

Murfreesboro Electric Dept. will be final authority.