

# MURFREESBORO ELECTRIC DEPARTMENT

615-893-5514

## OVERHEAD RESIDENTIAL TEMP. SERVICE

Date:	# of pages:
To:	From:
Co./Dept.:	Co./Dept.:
Phone #:	Phone #:
Fax #:	Fax #:


### \*\*\* RESIDENTIAL \*\*\*

Weather head must be 1' above customer's point of service drop attachment.

Service entrance conductors to extend 36" out of the weather head.

Residential service drop attachment minimum of 12' above ground and provide for the following service drop clearances:

yards.....12 feet  
driveways.....15 feet  
public roads.....18 feet

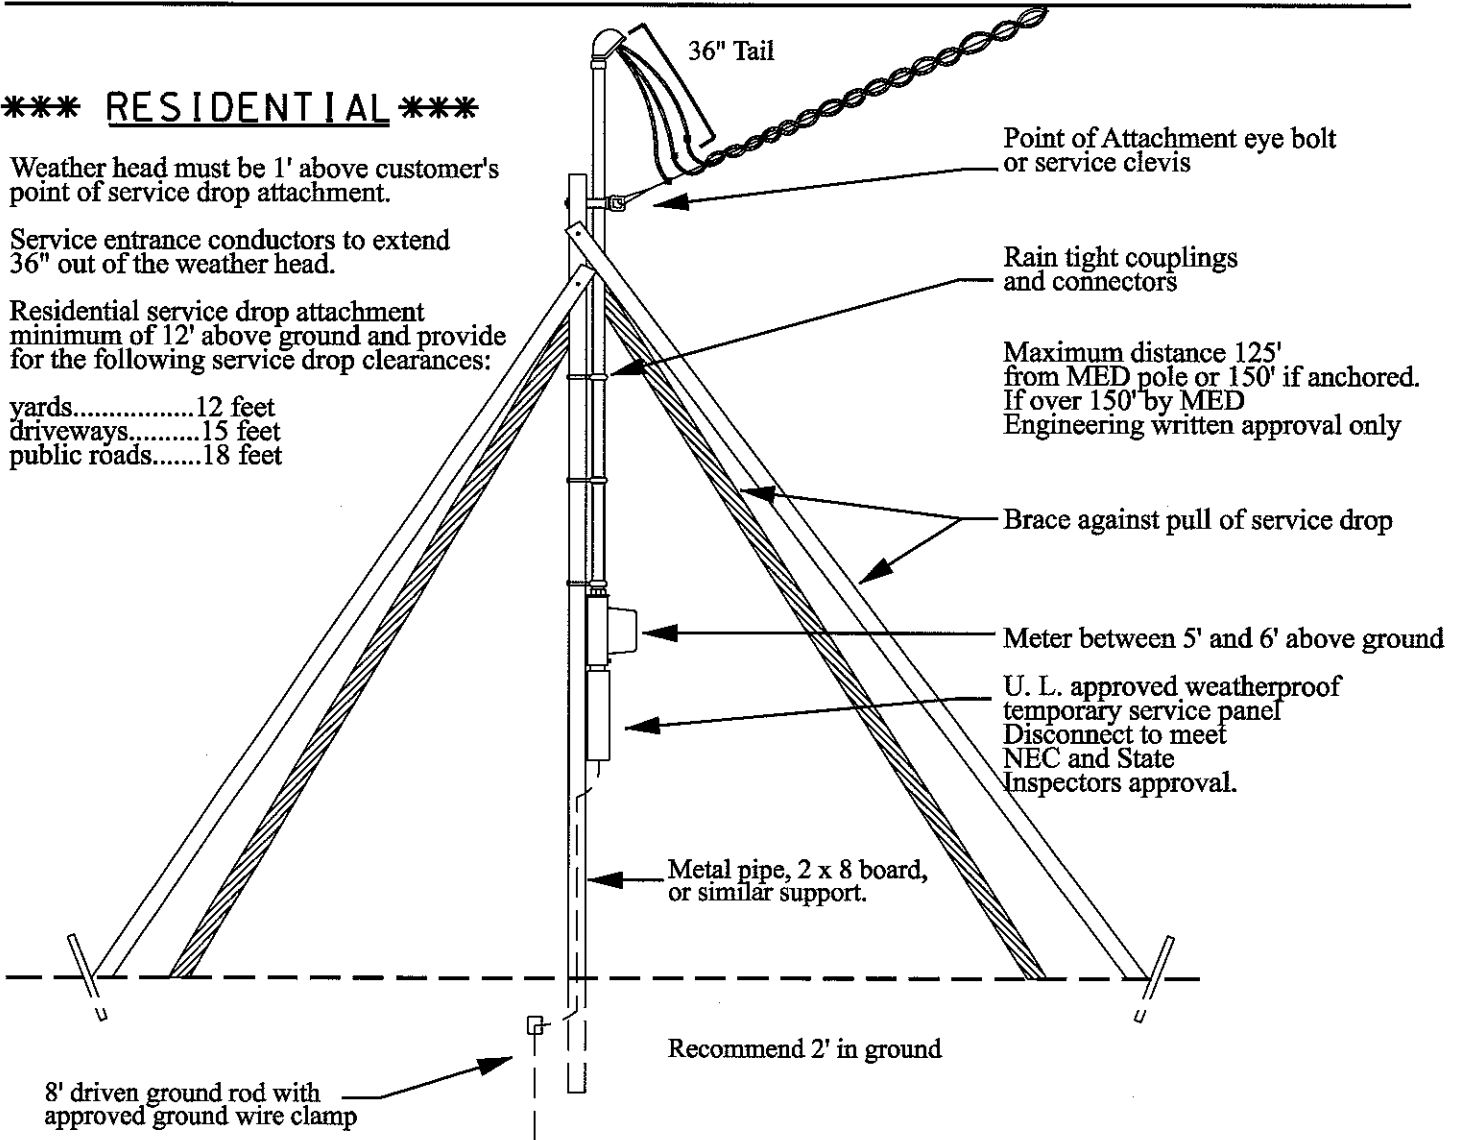

Must have current electrical inspection to be connected by MED.

Have Engineer to spot location on site for temporary service and permanent meter location.

Murfreesboro Electric Dept. will be final authority.